



Accredited for compliance
with ISO/IEC 17025.
Accreditation Number: 2735

REPORT 17/11570.7
12 July 2017

WET PENDULUM SLIP RESISTANCE TEST

Quick-Step Majestic Laminate – Woodland Oak.

Prepared for: Jennifer Lang
Premium Floors Australia
Unit 7/14 Rodborough Road
FRENCHS FOREST NSW 2086

Specimen Description: Quick-Step Majestic Laminate – Woodland Oak.
2050x240 mm.

No. of Specimens: 5 off (Sampling conducted by client).

Specimen Preparation: Washed with water and pH neutral detergent, rinsed then dried.

Test Condition & Slope: Unfixed. 0°

Test Direction: Test conducted parallel with surface profile.

Air Temperature: 21°C

Test Standard: AS 4586:2013 Slip resistance classification of new pedestrian surface materials, Appendix A – Wet Pendulum Test.

Test Location: Test Slip Australia Pty Ltd, Beaumont Hills, NSW.

Test Date: 22 June 2017

Test Equipment: Wessex Pendulum Skid Resistance Tester Serial Number SK1818, Calibrated 27/07/2016.

Slider Rubber: Slider 96 Batch #70 prepared on P400 & 3µm lapping film.

Test Personnel: Clark Ahearn

| Specimen Number: | 1 | 2 | 3 | 4 | 5 |
|-------------------------------------|-----------|----|----|----|----|
| Mean British Pendulum Number (BPN): | 35 | 35 | 35 | 35 | 33 |
| Slip Resistance Value (SRV): | 35 | | | | |
| Classification: | P3 | | | | |

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip-resistance be checked.



Clark Ahearn
Slip Testing Technician, NSW, ACT & TAS

Reviewed by:



Marcus Braché
Senior Engineering Technician
Approved Signatory

This report may not be reproduced except in its entirety.

Page 1 of 3

ATTAR Advanced Technology Testing and Research
A division of Engineering Materials Evaluation Pty Ltd ABN 14 006 554 785

Unit 1, 64 Bridge Rd, Keysborough VIC 3173. **T** (03) 9574 6144 **F** (03) 9574 6133 **E** admin@attar.com.au www.attar.com.au

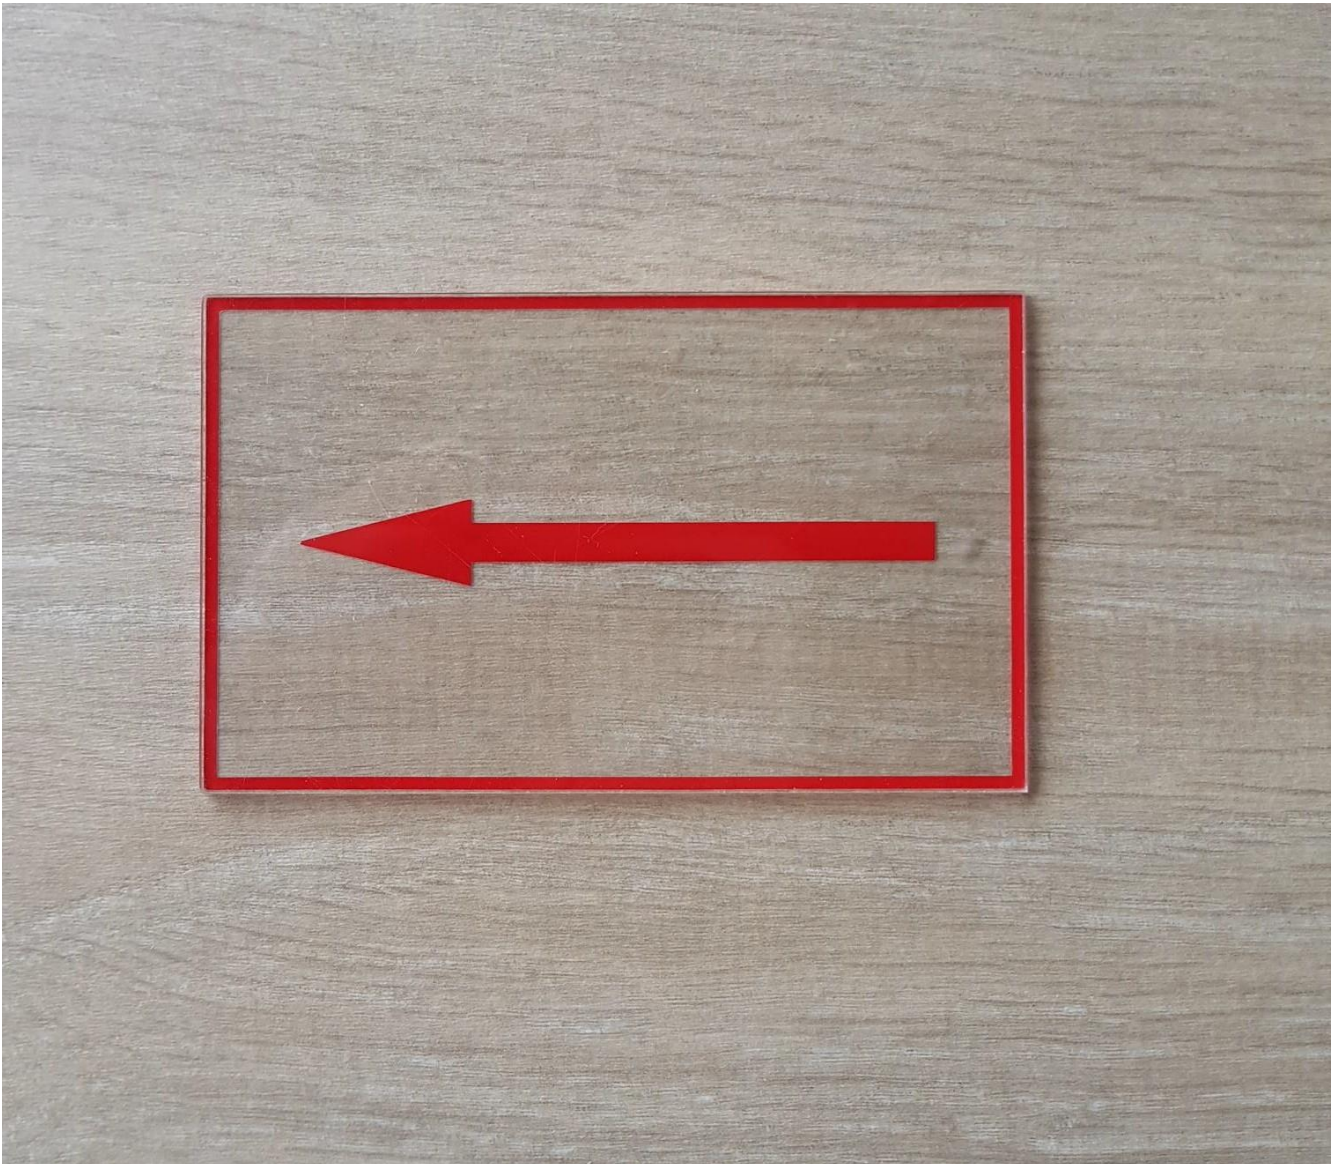


Figure 1: Quick-Step Majestic Laminate – Woodland Oak (MJ3545 Sample Image)

CLASSIFICATION CRITERIA – AS 4586 - 2013

Wet Pendulum Test - Appendix A

Slip resistance

When this Standard is used for the testing and classification of the slip resistance of carpets (or carpet-like products) in potentially wet locations, the carpet shall be tested using the wet pendulum test method set out in Appendix A of AS4586, and shall be reported as such.

When this AS4586 is used for the testing and classification of the slip resistance of carpets in dry locations, the test shall be carried out in the dry condition using the pendulum test method set out in Appendix A of AS4586, modified in accordance with Paragraph A2, and shall be reported as such.

The 'dry floor friction' test method in Appendix B of AS4586 is not suitable for heavily profiled surfaces or carpets.

Compliance

The surface shall comply with the stated classification for the test method and test rubber that is nominated and declared by the manufacturer or supplier.

**TABLE 2: CLASSIFICATION OF PEDESTRIAN SURFACE MATERIALS
ACCORDING TO THE AS 4586 WET PENDULUM TEST**

| Class | Pendulum SRV (see Note 1) | |
|-------|---------------------------|-----------|
| | Slider 96 | Slider 55 |
| P5 | >54 | >44 |
| P4 | 45-54 | 40-44 |
| P3 | 35-44 | 35-39 |
| P2 | 25-34 | 20-34 |
| P1 | 12-24 | <20 |
| P0 | <12 | |

NOTES:

- 1 While Slider 96 or Slider 55 rubbers may be used, the test report shall specify the rubber that was used.
- 2 It is expected that these surfaces will have greater slip resistance when dry.
- 3 SDV may be calculated by using the tables that are given in Appendix F of AS 4586, and the minimum SRV that is considered appropriate for a level surface (see examples given in Appendix F of AS 4586).

Means of demonstrating compliance

Pedestrian surfaces that are classified in accordance with Table 2 shall meet the following criteria:

- (a) The mean test results shall be as follows:
 - (i) For the classifications in Table 2, the mean of the test results shall be—
 - (A) within the relevant criteria set out in the table; and
 - (B) each individual result shall be equal to or above the lower limit for the classification or, if below the classification, within the mean of the result minus 20%.

If either criteria is not met, the lot shall be considered to be of lower classification.
- (b) The classification in accordance with Table 2 shall be determined by—
 - (i) selecting and testing at least five specimens at random as specified in Appendices A and B of AS4586; or
 - (ii) carrying out continuous testing and process control in accordance with AS 3942.
- (c) When testing individual lots, if a particular test fails to produce the expected classification it shall be permissible to—
 - (i) disregard the first sample, resample a minimum of 10 specimens from the whole lot, retest and apply the criteria to the new sample; or
 - (ii) subdivide the lot into smaller lots of different quality, resample, retest and reclassify each of the smaller lots.